



EN 215-1



## Small Valves

DIN-range with a higher  $k_v$ -value

VD1...CLC

- Valve body made of brass, mat nickel-plated
- DN 15, DN 20 and DN 25
- Internally and externally threaded (Rp/R) conforming to ISO 7/1
- Manual knob / protective cover included in the delivery
- Can be combined with motoric SSA..., thermal STA... and STS61- actuators

### Use

- For use in ventilation and air conditioning systems for water-side control of chilled ceilings and terminal units in closed circuits, e.g. for induction units, fan coil units, small re-heaters and small re-coolers.
  - 2-pipe systems with 1 heat exchanger for heating and cooling
  - 4-pipe systems with 2 separate heat exchangers for heating and cooling
- In closed-circuit zone heating systems, e.g. for:
  - Separate floors in a building
  - Apartments
  - Individual rooms

## Type summary

Type reference	DN	$k_v$ -value [ $m^3/h$ ] setting range
VD115CLC	15	0.25...1.9
VD120 CLC	20	0.25...2.6
VD125 CLC	25	0.25...2.6

### Order

When ordering, please give quantity, product name and type reference.

Example: 2 small valves VD120CLC

### Delivery

Valves, actuators and accessories are packed separately.

## Equipment combinations


Product	Types	Data sheet
Motoric actuators	SSA31... / SSA61... / SSA81...	N4893
Thermal actuators open / closed	STA21 / STA71	N4877
Thermal actuators DC 0...10 V	STS61	N4880

When the Siemens VD...CLC valves are combined with SSA61... actuators, the preadjustment must be set to 1.5 mm valve stroke (factory setting 0<sup>2)</sup>). If the valve travel is less than 1.5 mm, self-calibration is not possible and the valve with the actuator remains blocked.

## Mechanical and technical design

The valves make possible flow rate preadjustments by limiting the stroke. A preadjusting screw with reference numbers from 0 to 7 is located under the protective cover right by the valve stem.

- 1 Gland with preadjusting ring
- 2 Valve insert
- 3 Fitting with O-ring
- 4 Valve plug with soft disk
- 5 All valves are supplied with a protective cover. That cover facilitates shutoff when making the plant pressure test and manual adjustments for improvised plant operation during the construction phase.

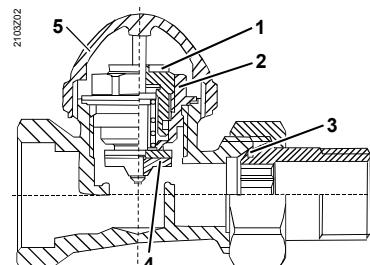

## Engineering notes

The reference numbers for preadjustment are given in the table with the  $k_v$ -values (see page 3) and in the valve sizing charts (see page 4).

1. Calculate the volumetric water flow  $\dot{V}_{100}$

$$\dot{V}_{100} = \frac{Q_{100}}{1.163 \times \Delta T \times f_1} \quad [\text{m}^3/\text{h}]$$

$Q_{100}$  = heat/refrigeration demand [kW]  
 $\Delta T$  = temperature differential [K]  
 1.163 = constant of water  
 $f_1$  = correction factor = 1 for water

2. Define the pressure drop  $\Delta p_{v100}$  across the fully open valve

In most types of plant, a differential pressure  $\Delta p_{v100}$  of 0.05 to 0.2 bar is adequate (5 to 20 kPa).

3. Calculation of the nominal flow value  $k_v$

$$k_v = \frac{\dot{V}_{100}}{\sqrt{\Delta p_{v100}}} \quad [\text{m}^3/\text{h}]$$

$\Delta p_{v100}$  = pressure drop across the valve [bar]

Example:	Heat demand	$Q_{100}$	= 4.7 kW
	Temperature differential	$\Delta T$	= 8 K
	Volumetric water flow	$\dot{V}_{100} = \frac{4.7}{1.163 \times 8}$	= 0.51 m <sup>3</sup> /h (510 l/h)
	Required pressure drop across the valve	$\Delta p_{v100}$	= 0.1 bar
	Flow	$k_v = \frac{0.51}{\sqrt{0.1}}$	= 1.61 m <sup>3</sup> /h

### Solution

According to the chart (refer to « Valve sizing charts») or table with  $k_v$ -values, the preadjustment required by a VDN120CLC valve is 6.

### Tips

- Noiseless operation is ensured by a pump that provides no more pressure than is needed to transport the required amount of water.
- To keep the valve free from dirt particles, it is recommended to install a strainer.
- If no pressure drop calculation is executed, preadjustment should be set with a differential pressure  $\Delta p_{v100}$  of 0.1 bar (10 kPa).

### Valve data


$k_v$ -values at the different preadjusted positions [m<sup>3</sup>/h]

Reference numbers for preadjustment	0 <sup>1)</sup>	1	2	3	4	5	6	7	0 <sup>2)</sup>
Valve stroke [mm]	0	0.188	0.375	0.563	0.75	0.938	1.125	1.313	1.5
VD115CLC	0	0.25	0.65	0.88	1.12	1.30	1.46	1.57	1.90
VD120CLC	0	0.25	0.60	0.91	1.18	1.43	1.64	1.85	2.60
VD125CLC	0	0.25	0.60	0.91	1.18	1.43	1.64	1.85	2.60
Flow tolerance [± %]	0	60	30	20	10	10	10	10	10

 Preadjustments < 5 are not recommended because the stroke resolution is too small.

### Note


- The  $k_v$ -values give the volumetric water flow  $\dot{V}$  in m<sup>3</sup>/h passing through the valve at a pressure drop  $\Delta p$  of 1 bar across the valve.
- The preadjusting ring permits 2 full revolutions. The values given in the table (reference numbers 0<sup>1)</sup>... 0<sup>2)</sup>) define the first revolution. After another revolution (reference number 0<sup>2)</sup>...6), the stroke still increases to 2.5 mm (fully open), but the  $k_v$  values will not exceed 0<sup>2)</sup>.
- The valves are supplied with the preadjusting ring fully opened. To make a preadjustment, the ring must first be fully closed – only then can the required reference number be selected. The markings on the different types are not necessarily identical.

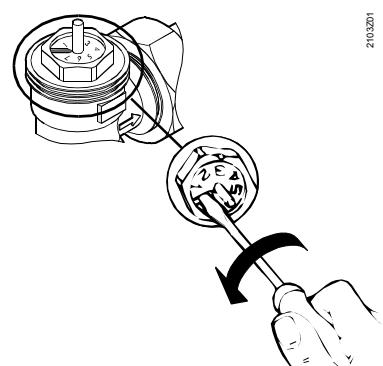

2103201


## Valve sizing charts

VD115CLC

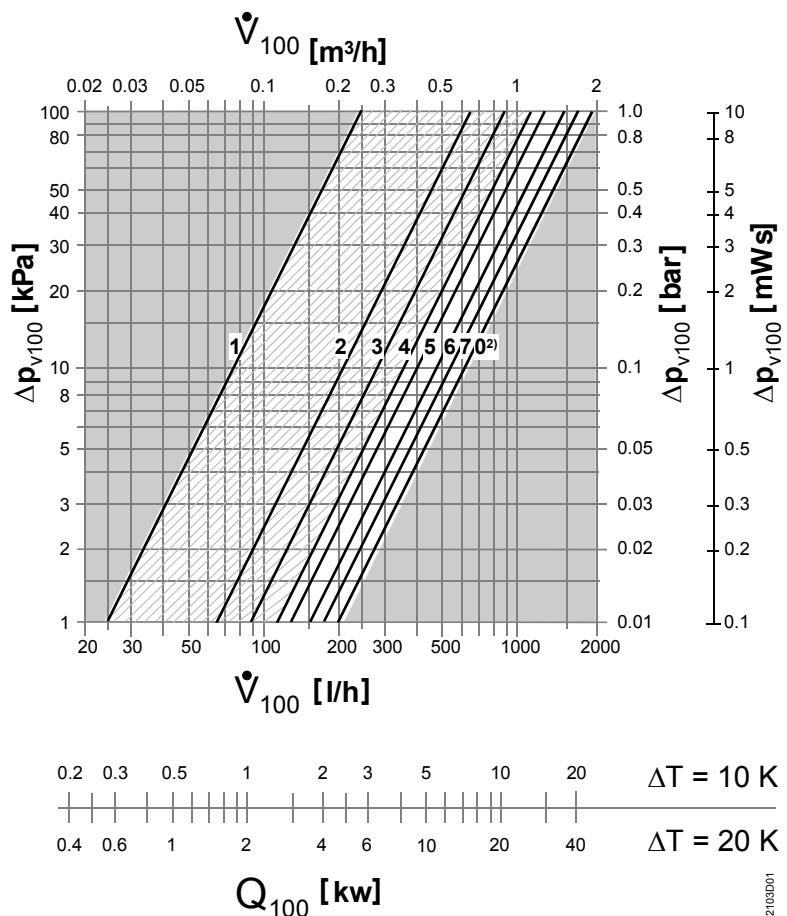

2103001

VD120CLC  
VD125CLC

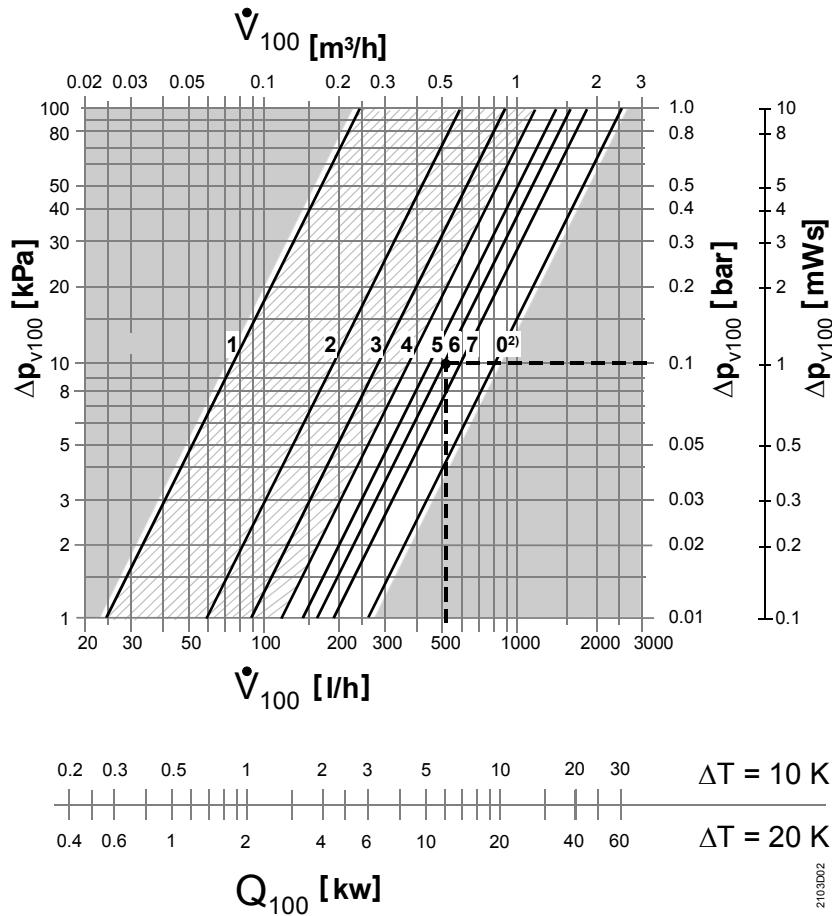


2103002

## Mounting notes

- Mounting Instructions are printed on the package.
- To ensure correct functioning of the thermostatic heads and motoric actuators, observe the available mounting choices and mounting conditions

### Orientation



4362201

## Maintenance

The small valves are maintenance-free.

### Repair

The valves cannot be repaired; the complete units must be replaced.

### Disposal



The valve must not be disposed of together with domestic waste.

Legislation may demand special handling of certain components, or it may be sensible from an ecological point of view.

**Current local legislation must be observed.**

## Warranty


Application-related technical data are only warranted when used in connection with the Siemens controllers and actuators listed under «Equipment combinations».

**When using the radiator valves with actuators of other manufacture, any warranty by Siemens Switzerland Ltd / HVAC Products becomes void.**

## Technical data

Functional data	PN class	PN 10
	Permissible media	chilled water, low temperature hot water, water with anti-freeze; recommendation: water treatment to VDI 2035
	Medium temperature	1...110 °C
	Perm. operating pressure	1000 kPa (10 bar)
	Differential pressure $\Delta p_{max}$	max. 150 kPa (1.5 bar)
	Differential pressure $\Delta p_{v100}$	5...20 kPa (0.05 ... 0.20 bar): recommended range
	Nominal stroke	2.5 mm
Industry standards	Pressure Equipment Directive	PED 97/23/EC
	Pressure Accessories	as per article 1, section 2.1.4
	Fluid group 2	without CE-marking as per article 3, section 3 (sound engineering practice)
Materials	Valve body	brass CuZn40Pb2, mat nickel-plated
	Fitting	brass CuZn40Pb2, mat nickel-plated
	Protective cover	polypropylene
	O-ring	EPDM
Dimensions / weight	refer to «Dimensions»	
	Mounting length	EN215
	Thread	Rp internally threaded to ISO 7/1 R externally threaded to ISO 7/1 G-thread to ISO 228/1

## Dimensions

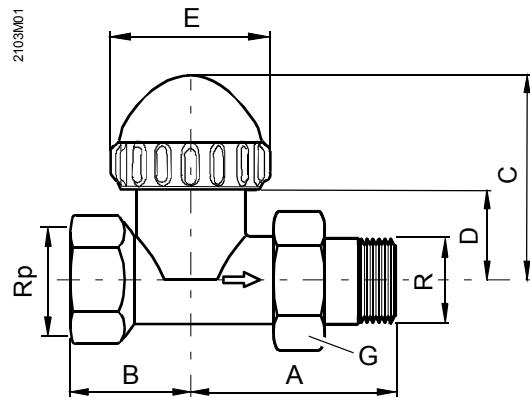

Type	DN	Dimensions [mm]					Thread [inch]			Weight [kg]
		A	B	C	D	E	Rp	R	G	
<b>VD115CLC</b>	15	61	33	46.5	24.5	35	1/2	1/2	3/4	0.28
<b>VD120CLC</b>	20	65	40	46.5	24.5	35	3/4	3/4	1	0.33
<b>VD125CLC</b>	25	68	35	46.5	24.5	35	1	1	1	0.42